


PIPE SUPPORTS
- SEE NOTE 3

UTILITY VAULT 4242-LA
WITH 2436-P COVER

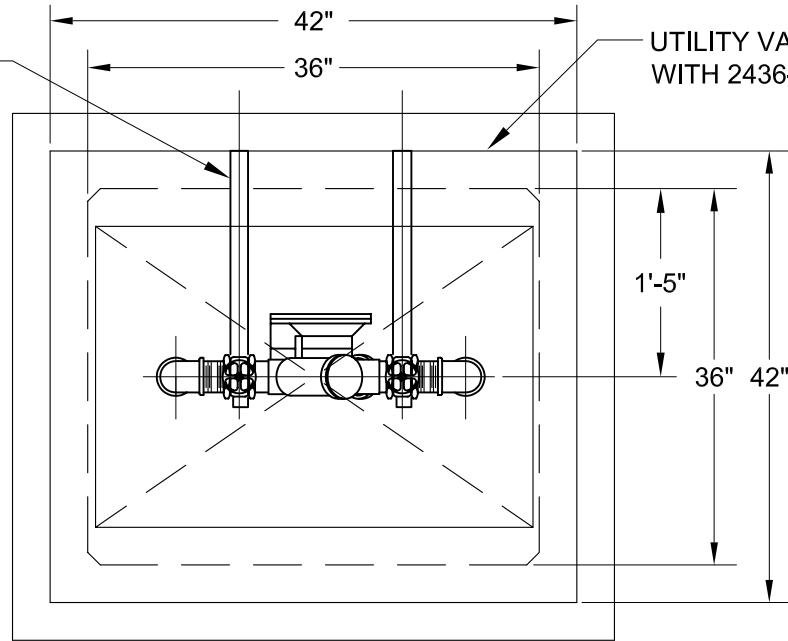


PLAN

CONCRETE PAD

REDUCED PRESSURE BACKFLOW
PREVENTER FEBCO MODEL 825Y

(BERM USE ONLY)
SLOPE EARTH AWAY FROM
VAULT IN BERM AREA

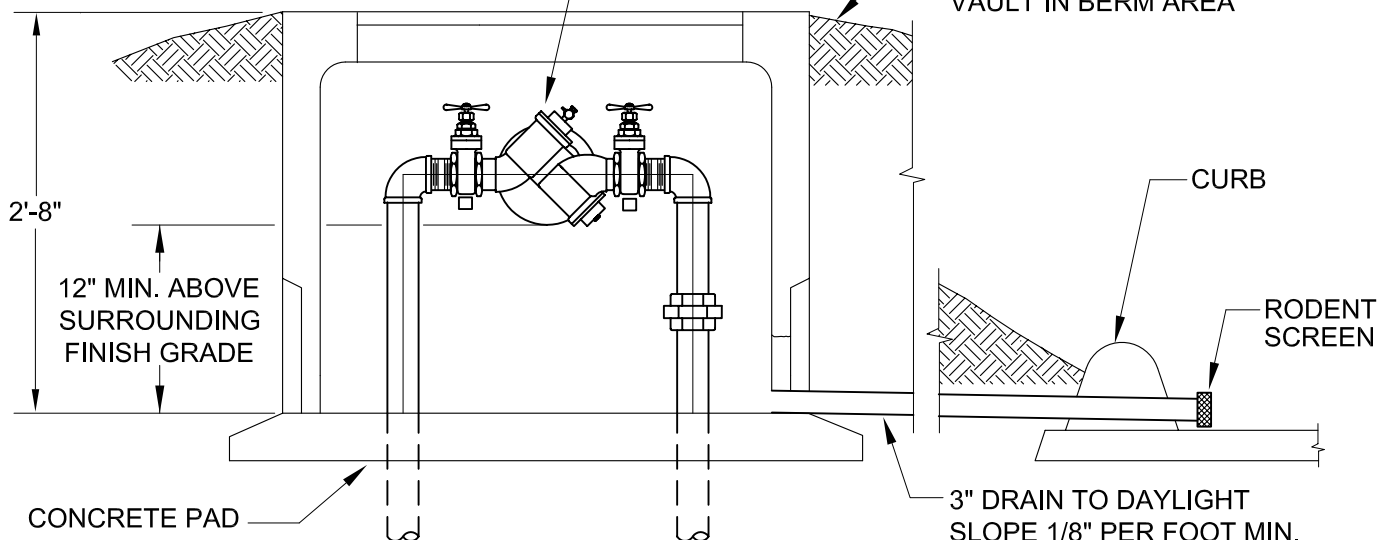

ELEVATION

NOTES:

1. This is an above ground installation. Drawing depicts installation in a berm.
2. This is to be a private facility, governed by *UPC* and *Oregon Dept. of Human Services*, as applicable.
3. Device is to be supported by substantial material, resistant to rust and decay. Supports are to be installed to prevent undue stress or strain to the device and its service piping.



City Of Beaverton

ENGINEERING
DEPARTMENT

PRIVATE
1-1/2" & 2" REDUCED PRESSURE
BACKFLOW PREVENTER

UTILITIES ENGINEER
David A. Winship, P.E.

DATE
6 - 10 - 04

DRAWN BY
CDH - WD

DRAWING NO.
661